Z:\-Project Directories\6200-6299\6277 - Republic Wire\-Construction Documents\6277-E4-0-ELECTRICAL-LIGHTING-ENLARGED-PLAN.dwg-EBS. Plot Date/Time: May 25, 2017-10:04pm - By: jason.rinderle
THESE DRAWINGS AND SPECIFICATIONS ARE NOT AUTHORIZED TO BE USED AS CONTRACT DOCUMENTS. THESE DRAWINGS HAVE BEEN PREPARED TO DEMONSTRATE COMPLIANCE WITH APPLICABLE CODES, AND ARE INTENDED TO PROVIDE THE AUTHORITIES HAVING JURISDICTION WITH INFORMATION TO DETERMINE CODE COMPLIANCE. THE INSTALLING CONTRACTOR IS RESPONSIBLE TO ENSURE THAT MEANS, METHODS, AND MATERIALS USED IN CONSTRUCTION ARE INSTALLED IN ACCORDANCE WITH ANY CONTRACTURAL AGREEMENT THAT MAY EXIST WITH AN OWNER, CONSTRUCTION MANAGER, GENERAL CONTRACTOR, ETC.

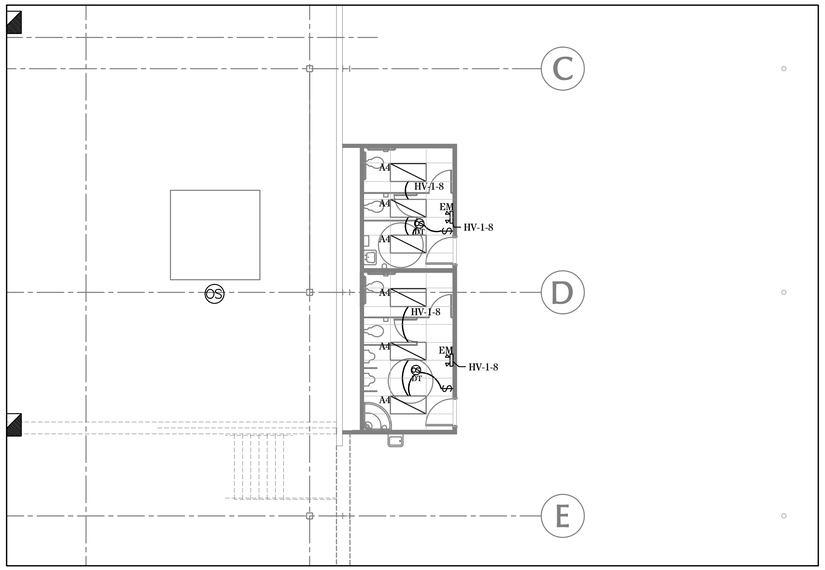


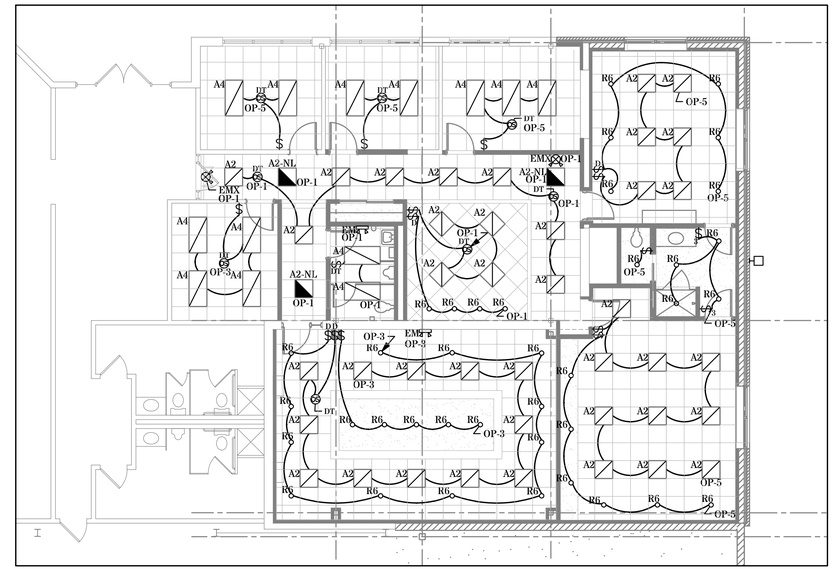


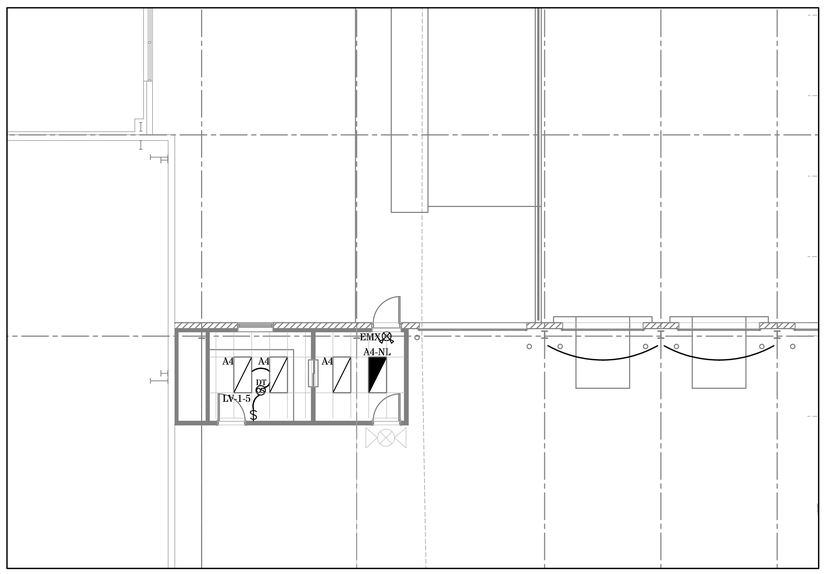


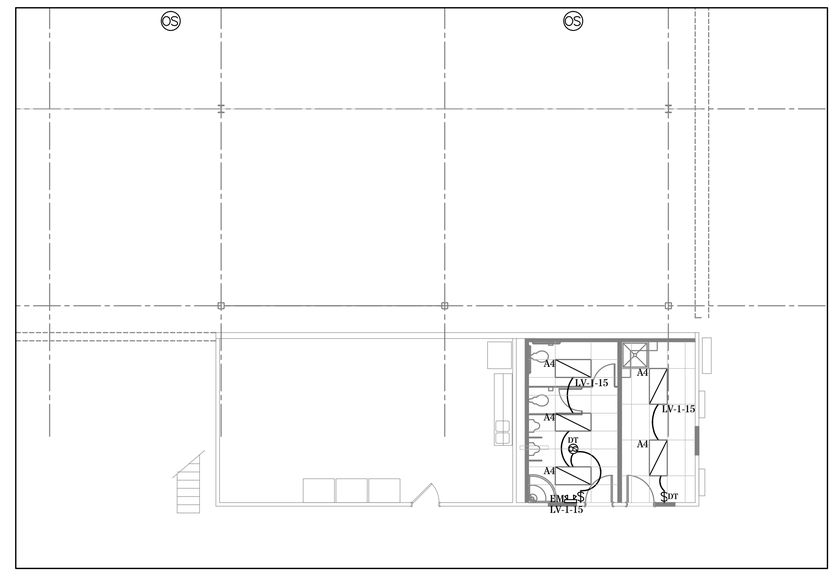


## ELECTRICAL LIGHTING ENLARGED PLAN

SCALE: 1/8" = 1'-0"

STATE OF OHIO
PAUL R. SARONG
PE 74471
REGISTERED
PROFESSIONAL ENGINEER

25 MAY 2017

## GENERAL NOTES-LIGHTING

A. REFER TO ARCHITECT'S PLANS AND ELEVATIONS FOR DIMENSIONED LOCATIONS OF LIGHT FIXTURES.

B. PROVIDE HOLD-ON-TYPE BREAKERS FOR EGRESS/EMERGENCY LIGHTING CIRCUITS. WIRE ALL EGRESS/EMERGENCY FIXTURES AHEAD OF ANY LOCAL SWITCHING.

C. LIGHT FIXTURES CONTROLLED BY SWITCH IN SAME ROOM UNLESS OTHERWISE NOTED

## DEMO NOTES

A. CONTRACTOR SHALL FIELD VERIFY EXACT LOCATION OF ALL EXISTING BUILDING CONDITIONS PRIOR TO ANY DEMOLITION/NEW WORK PERFORMED. COORDINATE ALL WORK WITH OTHER BUILDING TRADES, REPORT ANY MAJOR DISCREPANCIES TO ENGINEER PRIOR TO BEGINNING WORK. ACTUAL DEMOLITION AMOUNT SHALL BE BASED ON FIELD VISIT BY CONTRACTOR.

B. ALL NECESSARY SHUT DOWN OF POWER MUST BE SCHEDULED SO AS NOT TO DISTURB OPERATION.

C. CONTRACTOR SHALL RETURN ALL DEMOLITION EQUIPMENT TO OWNER'S REPRESENTATIVE FOR SALVAGE, OR REMOVE FROM PREMISES AT OWNERS OPTION.

D. CONTRACTOR SHALL DISCONNECT ALL POWER AND LOW VOLTAGE WIRING FROM EQUIPMENT BEING REMOVED BY OTHER TRADES.

E. REMOVE ALL ELIMINATED CONDUIT AND WIRE FROM PROJECT AREA. PROVIDE FIRE STOPPING WHERE REQUIRED. ALL ABANDONED CONDUIT, AND DEVICES ENCASED IN CONCRETE SHALL BE CUT BACK FLUSH WITH SLAB. PATCH CONCRETE LEVEL WITH EXISTING SLAB.

F. ALL CIRCUITS SHALL BE VERIFIED BY CONTRACTOR PRIOR TO DEMOLITION. ALL EXISTING CIRCUITS TO ITEMS TO REMAIN IN SERVICE SHALL BE MAINTAINED. ALL RELOCATING AND REROUTING SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.

G. PRIOR TO DEMOLITION, FIELD VERIFY EXACT SIZE AND ROUTING OF ALL EXISTING WIRING TO BE ENCOUNTERED. CONTRACTOR SHALL REMOVE ALL ABANDONED OR UNUSED WIRING WITHIN HIS SCOPE OF WORK AND TERMINATE PROPERLY. ANY ACTIVE WIRING DISTURBED BY THIS WORK SHALL BE RECONNECTED PRIOR TO PROJECT CLOSEOUT.

H. ALL EQUIPMENT AND RECEPTACLE CIRCUITS BEING ELIMINATED IN DEMO TO BE REMOVED BACK TO SOURCE UNLESS OTHERWISE NOTED.

I. ALL LIGHTING CIRCUITS ELIMINATED IN DEMO TO BE REMOVED BACK TO SOURCE. RETAIN ALL FIXTURES FOR USE IN EXPANSION AREAS OR DISPOSAL BY OWNER.

MSP
McGill Smith Punshon, Inc.
3700 Park 42 Drive Suite 190B
Cincinnati, Ohio 45241-2097
Tel. 513-759-0004 ▪ Fax 513-563-7099
Engineers ▪ Architects ▪ Surveyors
Planners ▪ Landscape Architects

| | | | |
|---|---|---|---|
| Drawn by | JHR | Project Mgr. | KPO |
| Checked by | PRS | | |

| Issue/ Revision | Revision Number | Date |
|---|---|---|
| BID / PERMIT | | 05/25/17 |

PR-06164
ENGINEERED BUILDING SYSTEMS INC.
TEAMWORK • COLLABORATION
SHARED SUCCESS
515 Monmouth Street, Suite 204
Newport, KY 41071 (859) 261-0585
MEP Consulting Services, Inc. in OH
Copyright © 2015
THIS DOCUMENT IS THE PRODUCT AND EXCLUSIVE PROPERTY OF ENGINEERED BUILDING SYSTEMS, INC. NEITHER THE DOCUMENT NOR THE INFORMATION IT CONTAINS MAY BE USED FOR OTHER THAN THE SPECIFIC PURPOSE FOR WHICH IT WAS PREPARED WITHOUT WRITTEN CONSENT OF ENGINEERED BUILDING SYSTEMS, INC.

# RENOVATIONS AND ADDITIONS FOR *Republic Wire*

UNION CENTRE DRIVE
WEST CHESTER, OHIO 45069

Sheet Title
ELECTRICAL LIGHTING PLAN

Project No. 97333.33
Scale AS NOTED
Sheet No. E4.0